




GEOLOGICAL SURVEY OF CANADA BOREHOLE :LV97-1

Natural Gamma Conductivity (cps) Magnetic Susc. (ppt SI) Rel. Density* Spectral Density Ratio**
56 58 60 20 40 60 80 0 2 4 6 8 10 15000 10000 5000 1.1 1.2 1.3 1.4
DENSITY INCREASING

ZONE 18
5018950 N
488500 E

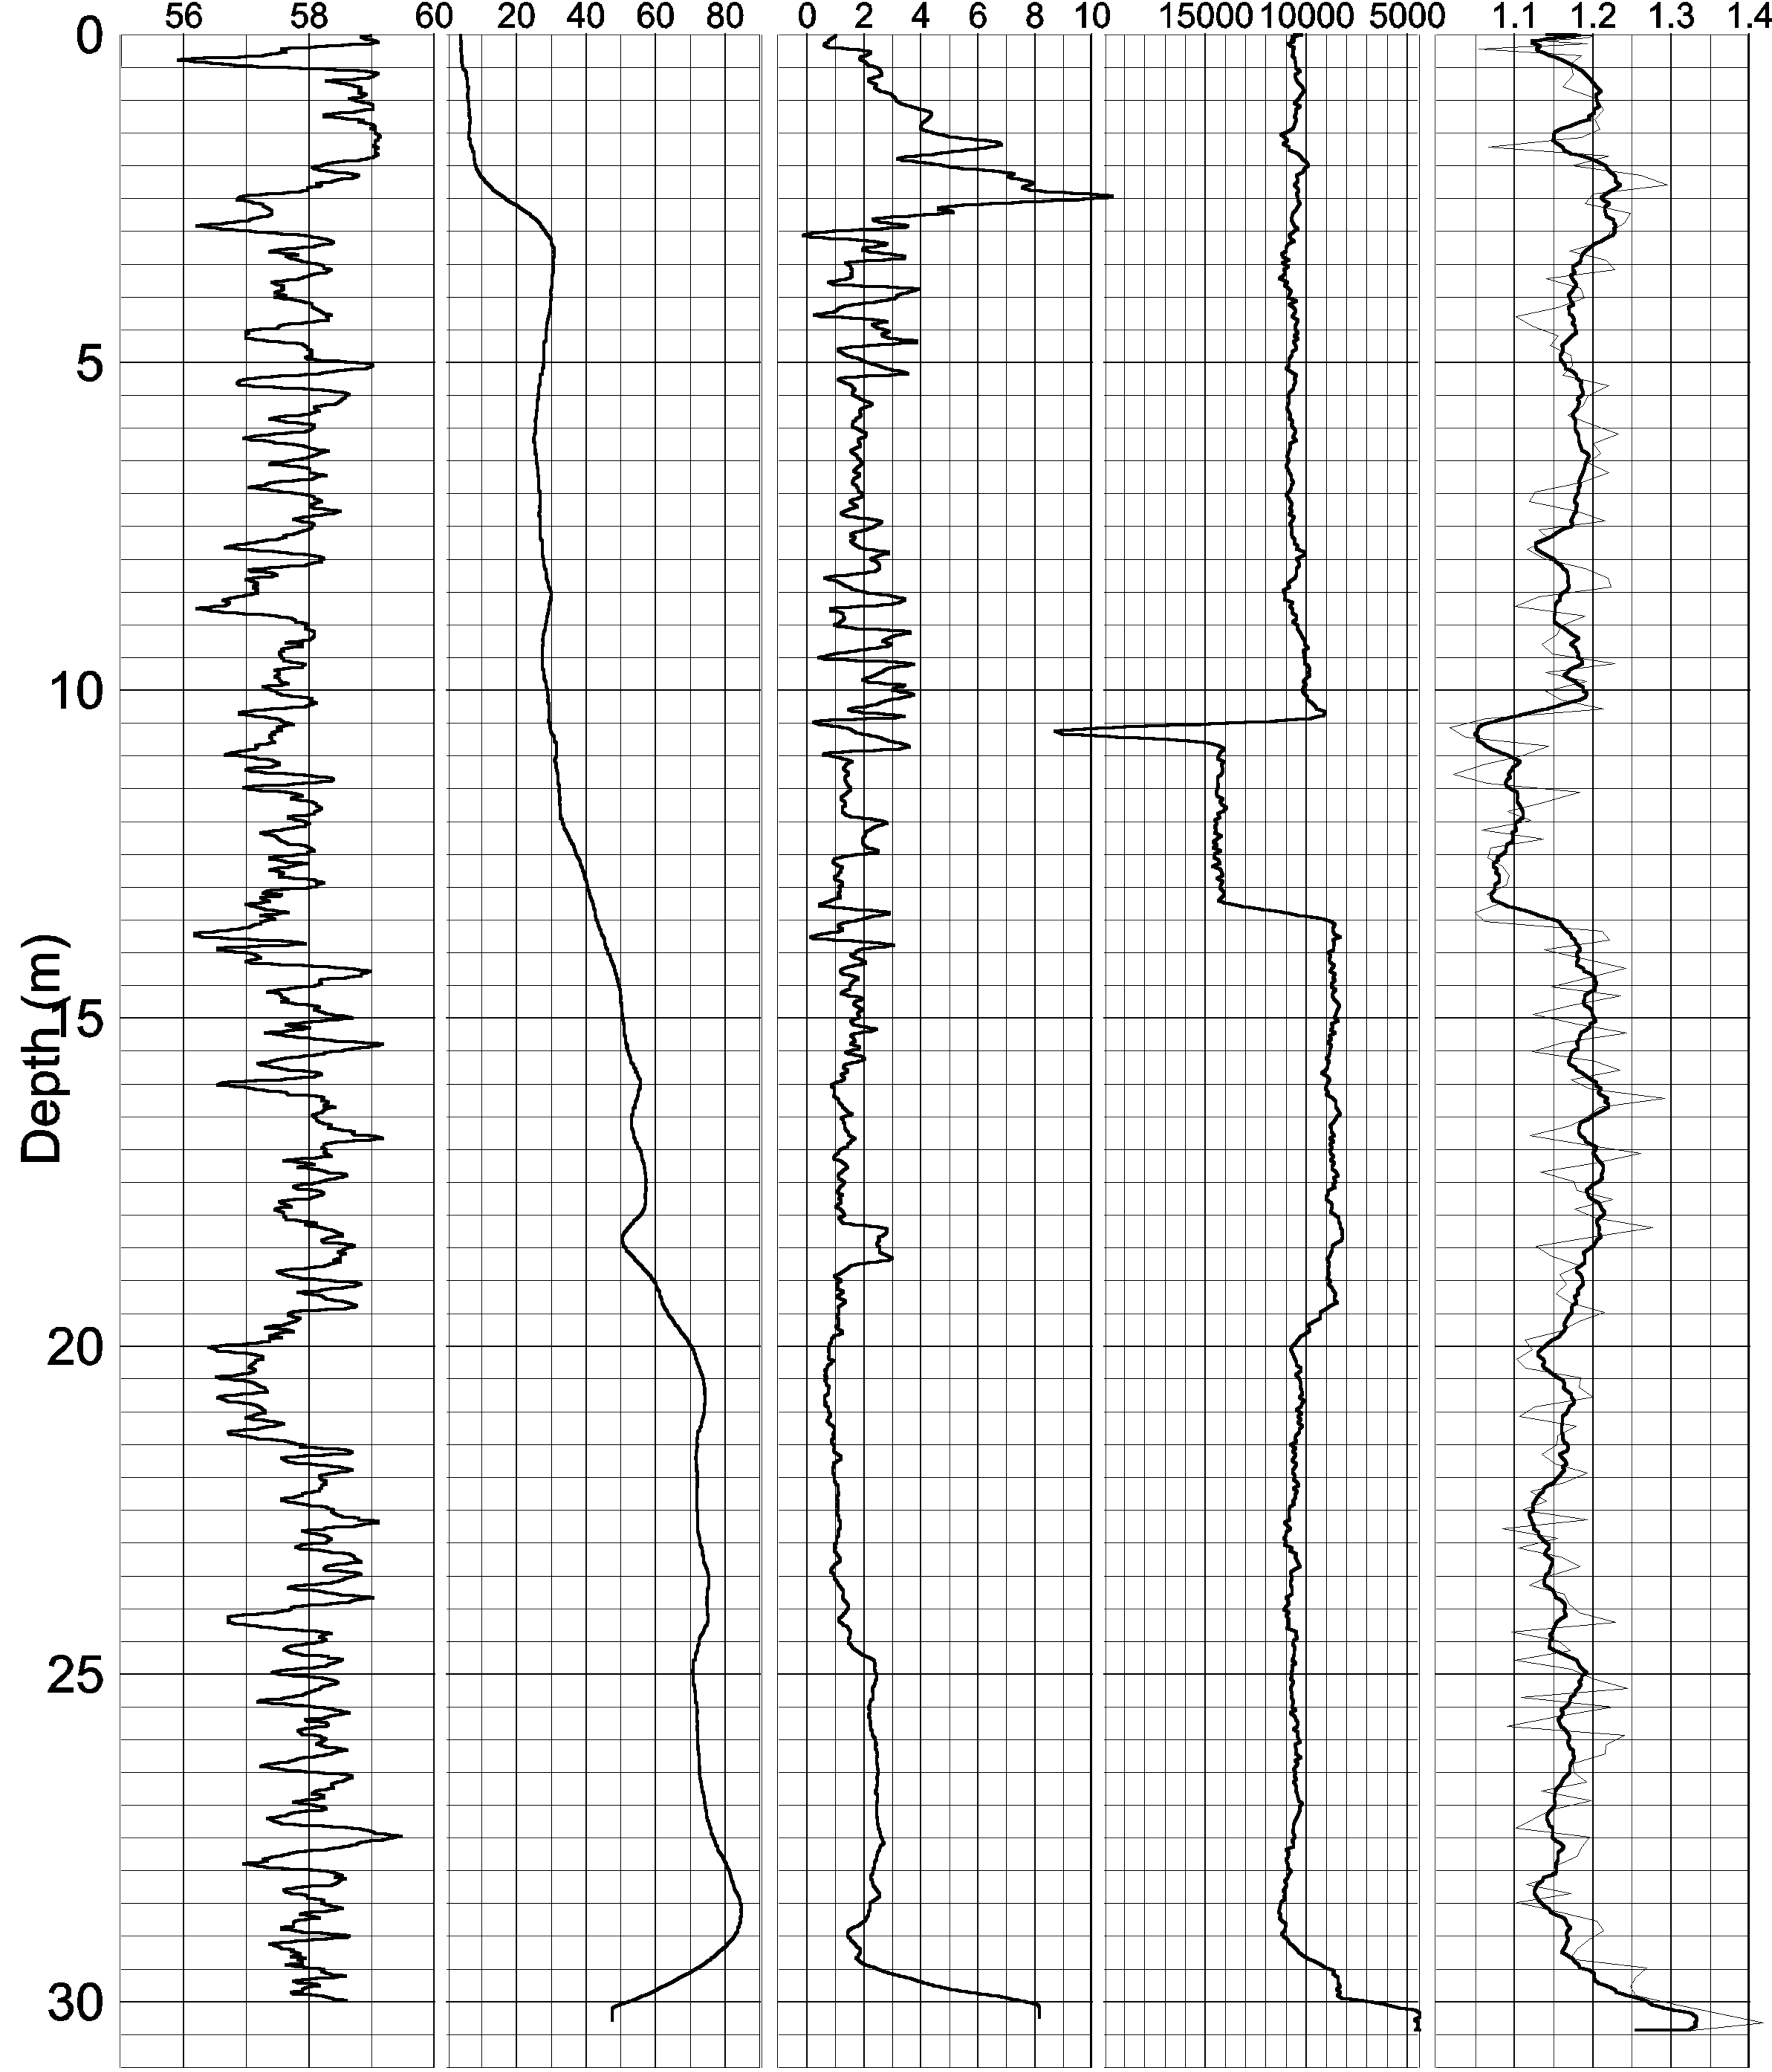

*COUNT(50-800keV) 5% SMOOTHING

** $(366-800)/(90-140)$ keV